



NON-FERROUS WM

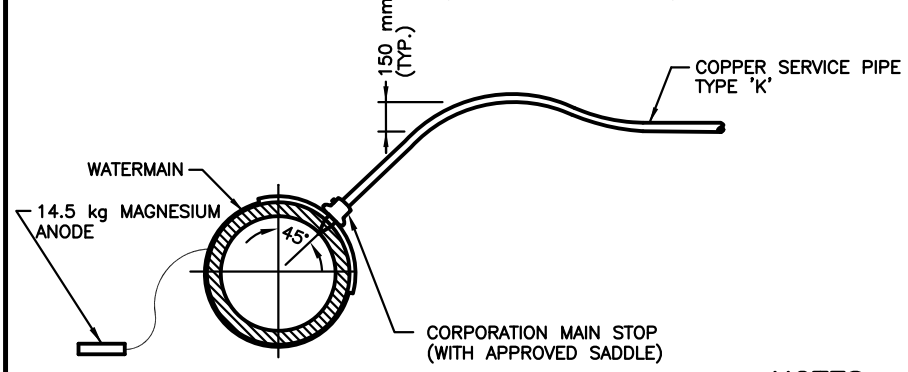

FERROUS WM

NOTES

1. THE WATER CONNECTION SHALL BE LAID FROM THE MAIN TO 150 mm BEYOND THE PROPERTY LINE, IN NEW SUBDIVISIONS ONLY.
2. HORIZONTAL GOOSE NECK SHALL BE USED WHEN COVER LESS THAN 1700 mm.
3. WATERMAIN SHALL BE TAPPED UNDER PRESSURE.
4. SERVICE GROUND CLAMPS AND SPLIT BOLT SHALL BE WRAPPED WITH ELECTRICAL PUTTY.
5. ANODE SHALL BE PLACED AT LEAST 1.0 m AWAY FROM THE SERVICE AND AS DEEP AS THE BOTTOM OF THE SERVICE.
6. ANODE SHALL BE LOCATED BETWEEN THE MAIN STOP AND CURB STOP.
7. PLUMBING CONTRACTOR TO REMOVE TAIL PIECE AND HOOK UP TO CURB STOP.
8. CATHODIC PROTECTION, BONDING CABLE AND TRACER WIRE SHALL BE AS PER S-201.030, S-201.031.
9. MINIMUM SEPARATION DISTANCE BETWEEN TAPPED COUPLINGS SHALL BE 1.0 m.
10. COUPLINGS SHALL NOT BE PERMITTED BETWEEN THE MAIN STOP AND THE CURB STOP WITHOUT PERMISSION OF THE REGION OF DURHAM,

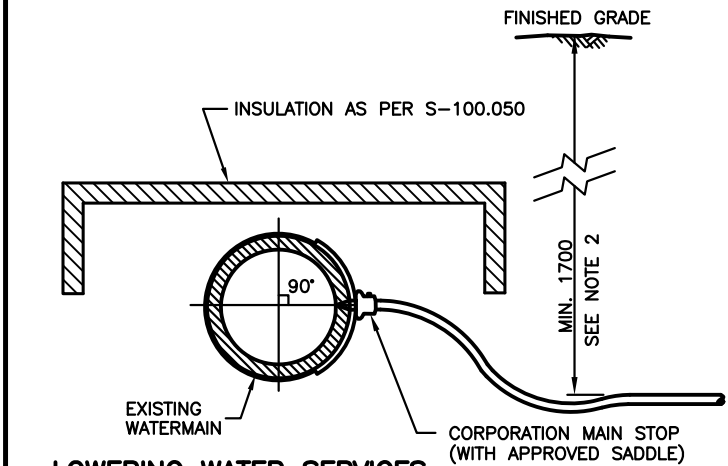

LOWERING WATER SERVICES

ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED.



19 mm AND 25 mm COPPER WATER SERVICE

DWG. DATE:	1981 04
REVISION NO.:	19
REV. DATE:	2014 04
SCALE:	N.T.S.

S-230.020